

Resource
Data Management

Bluetooth Monitor 2 Input 2 Output

Commissioning/ User Guide
Revision 2.3



PR0631-2I2O

Contents

Bluetooth Mesh Systems	3
Bluetooth Technology	4
Typical Non-Bluetooth Mesh Network	4
Typical Bluetooth Mesh Network	4
Connections	5
Input/ Output Allocation Table	6
2I2O Example System	6
Bluetooth Mesh Setup on Data Manager	7
Network Channel	8
Network ID	8
LED Operation	8
Bluetooth Access Point	9
PR0632-DIN	9
PR0632-SF	10
IP Configuration	12
Multiple Bluetooth Access Points	13
Logging on a 2I2O Monitor to the Data Manager	13
Parameter Table	14
Defrost	15
Defrost Overrun	15
Defrost Recovery Period	15
Relay State and functional operation	15
Network Alarms	15
Remote Relays	15
GP Timer Configuration	16
Data Builder	17
Technical Specification	18
Technical Specifications – PR0632-SF/DIN	19
Maximum Number of Devices per Network	20
Related Part Numbers	20
Cleaning	20
Mounting and Installation Instructions	20
Network Repeater	21
Warranty Information	21
Disclaimer	21
Revision History	21

Before installing or using this product, read the contents of this guide thoroughly to familiarise yourself with all the operating parameters and features. Please refer to the safety information detailed in the [Technical Specification](#) section. The host equipment **must** provide adequate protection against contact to hazardous live parts.



Please ensure all power is switched off before installing or maintaining this product.

Bluetooth Mesh Systems

From Resource Data Management

The RDM Bluetooth 2I2O monitor has 2 inputs and 2 relay outputs. Each input can be configured as either a temperature probe or plant fault input. If configured as a temperature probe each input has an over and under temperature alarm set point as well as an associated alarm delay. There is an option to offset each temperature probe input to compensate for long cable runs. Input 2 can also be configured as a defrost input for probe 1 and features a defrost overrun alarm.

When set as plant fault each input has the option to be either normally open or normally closed with an alarm delay. The two relay outputs are remote relays and are available for use by a Data Manager GP timer channel or The Data Builder (TDB) software.

The Bluetooth 2I2O monitor uses the latest in Bluetooth mesh technology.

The 2I2O monitor is logged on to a Data Manager front end system, via a Bluetooth Access Point (PR0632-SF or PR0632-DIN), without the need for a full site wired network infrastructure. This provides greater flexibility for monitoring and control solutions for applications where the installation of a wired network isn't feasible or cost effective.

The 2I2O monitor obtains its power supply from the supplied external 5Vdc power supply.

The 2I2O monitor supports; PT1000, NTC2K, 470R, 700R, 3K, NTC2K25, 5K, 6K, NTC10K or NTC10K (2) temperature probes.

Note: Probe types cannot be mixed.

Note: Bluetooth is only available from DMTouch software version V3.2.1 and above



Please ensure all power is switched off before installing or maintaining this product.

Bluetooth Technology

Typical Non-Bluetooth Mesh Network

Shown below is a typical Wireless network. In Fig 1. Each Wireless device communicates directly to a central point which is the gateway. Any data provided by a device on the Wireless network is relayed via this gateway.

Fig 1


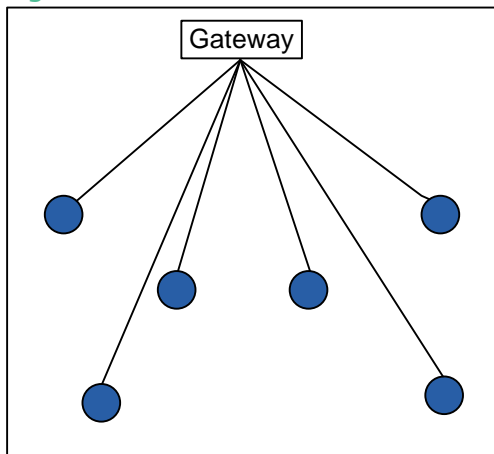


Fig 2

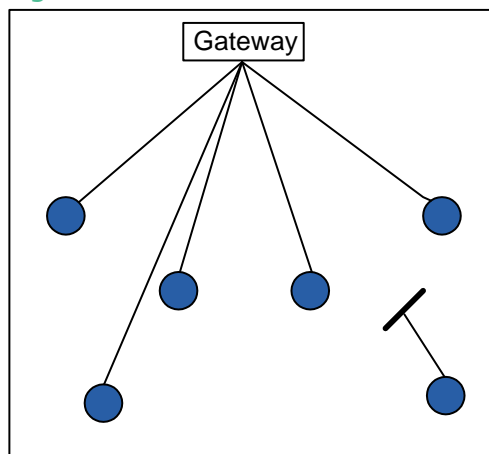

If any single Wireless device loses direct communication with the gateway, e.g. a structure is erected in front of the unit as seen in Fig 2, then the Wireless device would be unable to send/receive any data to/from the gateway. This results in having to either move the Wireless device, the obstruction or the gateway to restore communication.

Typical Bluetooth Mesh Network

Shown below is the RDM Bluetooth mesh system (Fig 3).

Fig 3


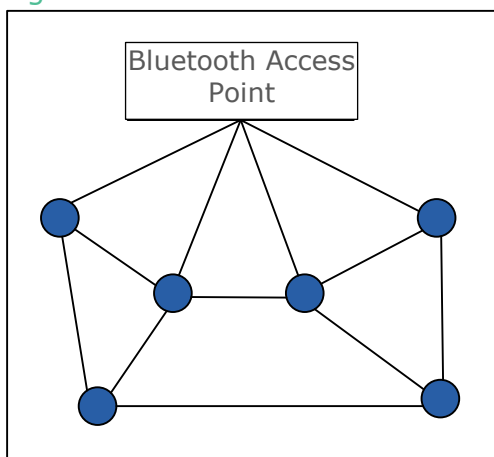


Fig 4



With the RDM Bluetooth mesh system, Bluetooth devices 'talk' to each other as oppose to only the gateway. Where a device doesn't have direct communication with the Bluetooth Access Point, its data can be forwarded via one of the other Bluetooth mesh devices which is in range of the Bluetooth Access Point as shown in Fig 4.



RDM recommends that at least one repeater is used for every 8 devices. This should ensure that there is enough coverage to create the Bluetooth mesh network for each module to communicate back to the DMTouch. The repeaters should be located in places to help the mesh network spread across the area that the probes are located in.

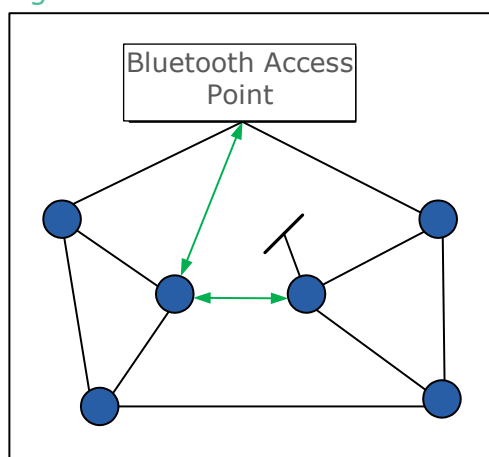

Please ensure all power is switched off before installing or maintaining this product.

Connections

The diagram below shows the connection detail for the 2I2O monitor. Inputs are assigned according to the chosen configuration. See [Input/ Output tables](#) for further details on connections.

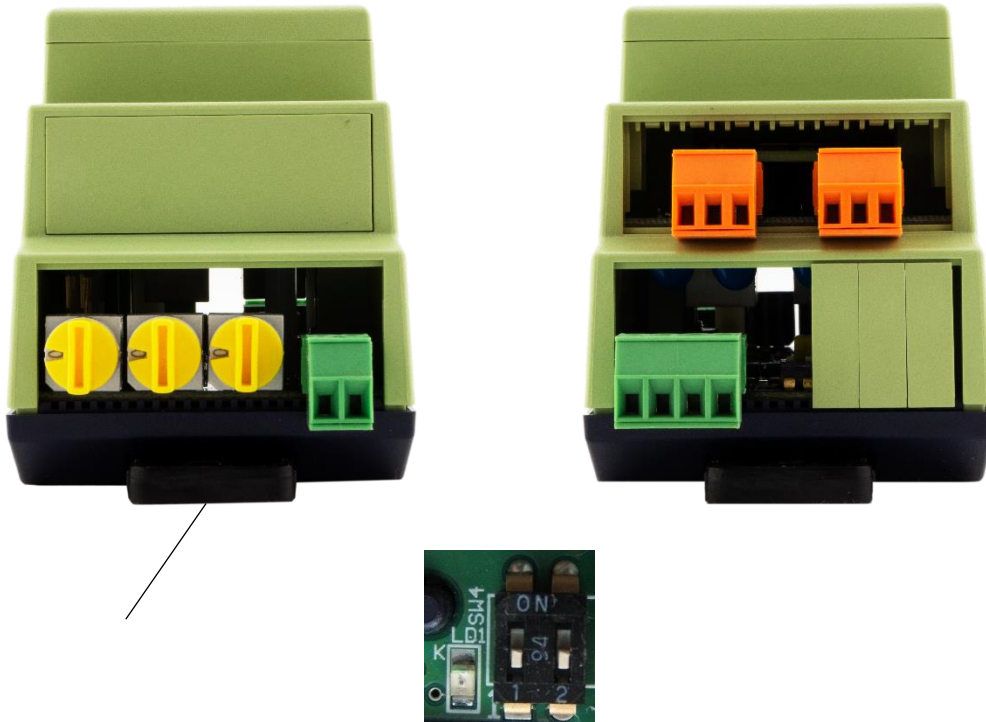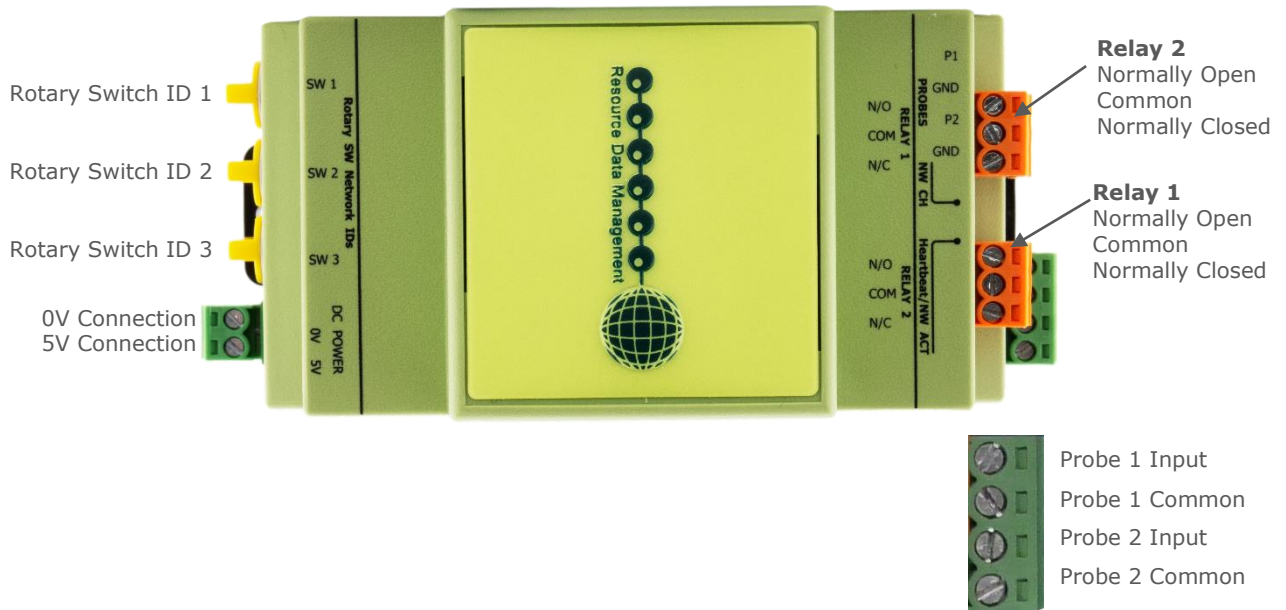

Network LED and [Channel Selector Switch](#)

Note: - The monitor comes supplied with a 5V Din Rail mount PSU.



Do not connect an earth.



Please ensure all power is switched off before installing or maintaining this product.


Input/ Output Allocation Table

The following table indicates the functions of the inputs and outputs.

2I2O Monitor	Description	Alarm Action
Probe 1	Probe 1 or Plant Fault 1	Yes
Probe 2	Probe 2 or Plant Fault 2 or Defrost Input	Yes
Relay 1	Remote Relay 1 (GP Timer or TDB)	N/A
Relay 2	Remote Relay 2 (GP Timer or TDB)	N/A

2I2O Example System

Below is a simplified example of a site setup.

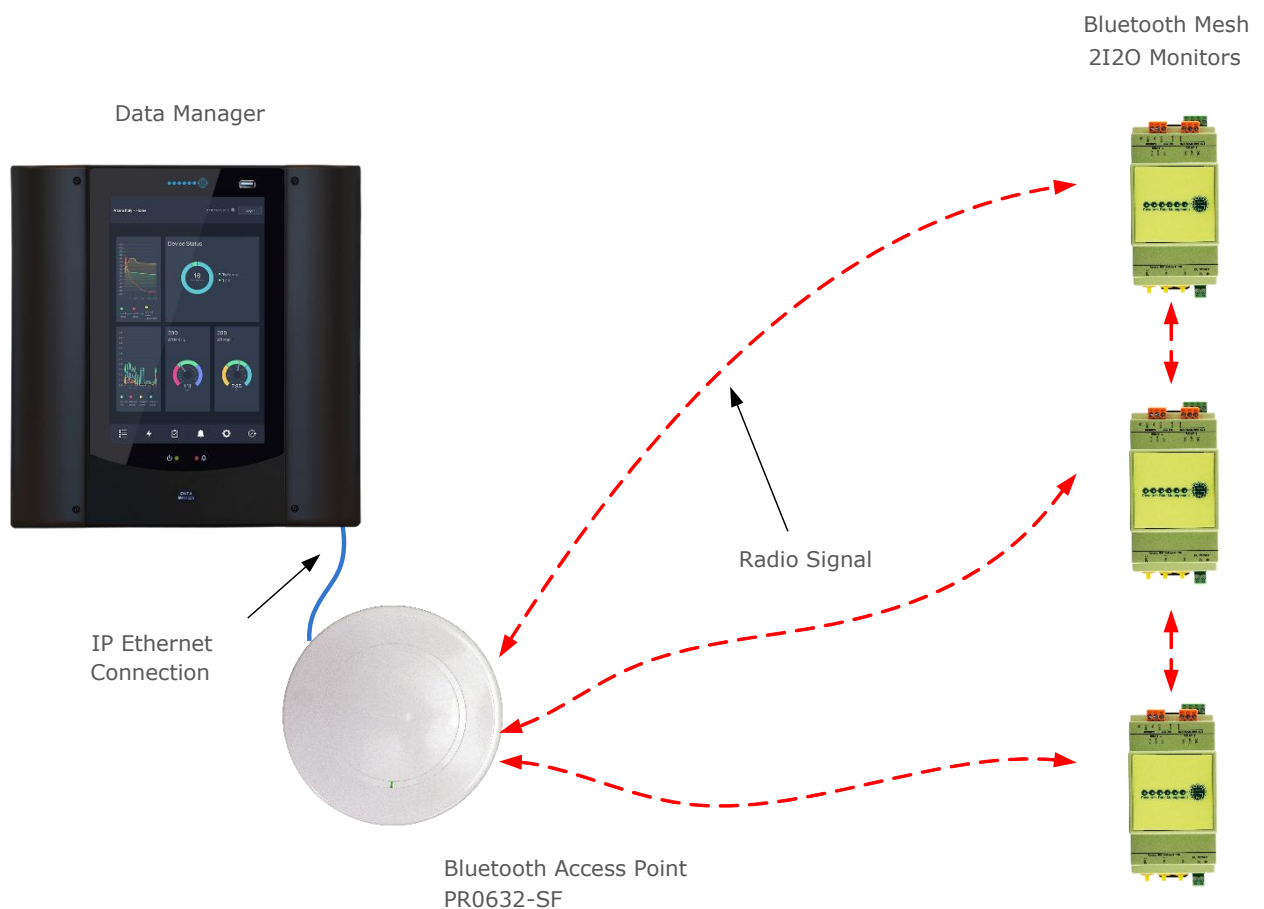

In the above example a number of 2 Input 2 output monitors are connected to a Data Manager via the Bluetooth Access Point. The Bluetooth Access Point, is connected to the Data Managers Ethernet 0 IP network via a CAT5 patch cable (see section on [Bluetooth Access Point](#)). The Bluetooth mesh 2I2O monitor transmits data to/ from the Bluetooth Access Point as a radio signal. The Bluetooth Access Point in turn passes the data on to the Data Manager via its Ethernet network connection. This same process allows the Data Manager to send data to the 2I2O monitors.




Please ensure all power is switched off before installing or maintaining this product.

Bluetooth Mesh Setup on Data Manager


From the Service Menu select: Devices/ Network/ RDM Bluetooth Wireless Mesh

The following guide should be used to configure an RDM Bluetooth Access Point for use with a DMTouch. Up to 4 Bluetooth Access Point can be connected to the DMTouch's Ethernet 0 network. This is advantageous should the wireless network be split across multiple floors in a building.

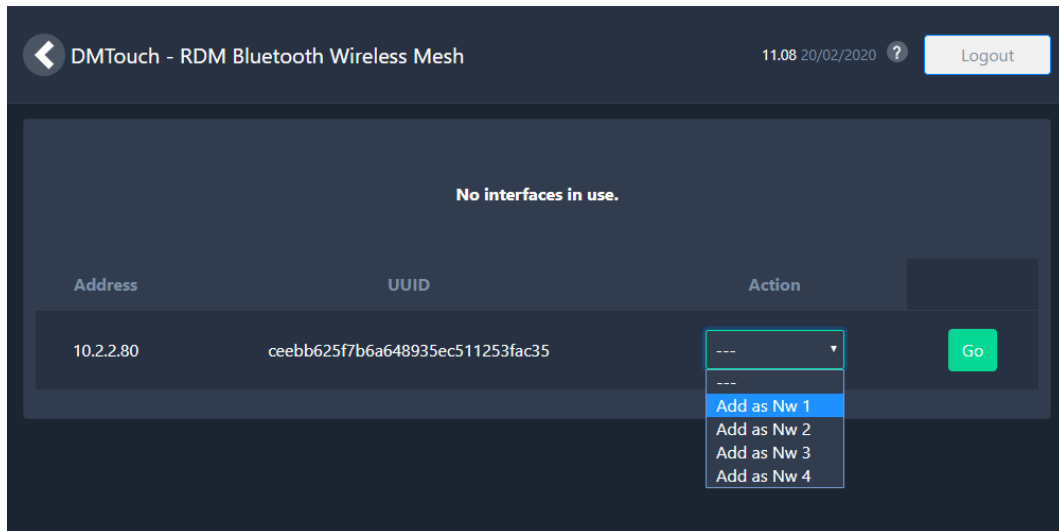

Shown above is an example screenshot from the DMTouch's 'Bluetooth Setup' page. It shows no current interfaces in use and a single Bluetooth Access Point that has not yet been configured. As mentioned above up to 4 Bluetooth Mesh networks can operate simultaneously. The first step is to set the Access Point's Network number from the 'Action' drop down menu and click 'Go'.

Once the unit has been added as a network it will list it in the below table.

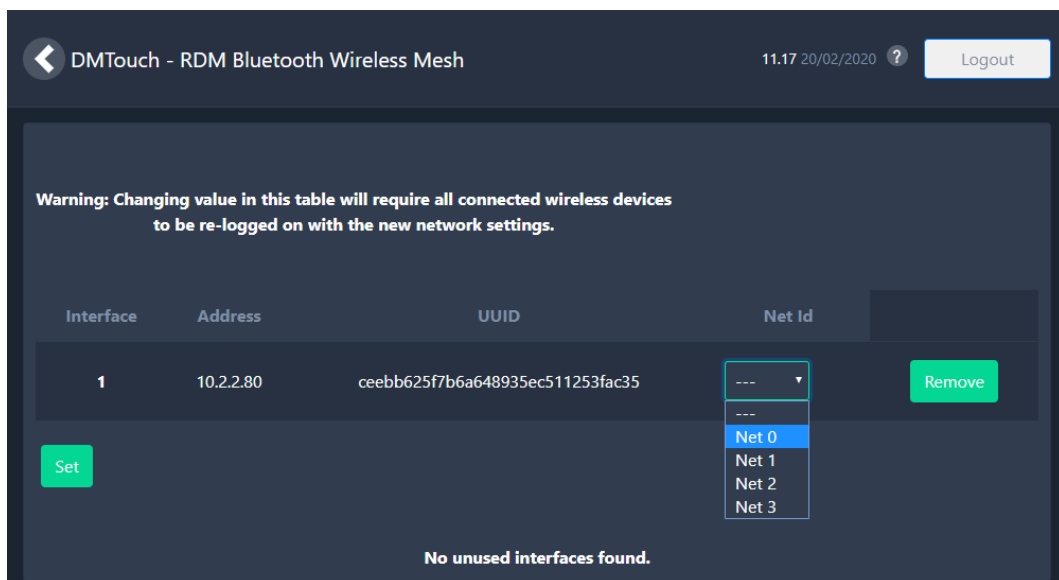

From here, select the desired Net ID (0 – 3) from the drop-down menu.

Note: Any Bluetooth mesh device to be logged on to the DMTouch via this Access Point must have its [network channel switch](#) set to the same Net ID selected for the Access Point.

Press 'Set' to save any changes made.

Now configure the wireless mesh device that is to be logged on to the DMTouch.



Please ensure all power is switched off before installing or maintaining this product.


Note: The software feature 'DMTouch Bluetooth Mesh Software Enabler' (PR0635) will allow 32 devices to be logged on to the DMTouch. This can be over a single Access point or multiple Access points. A maximum of two PR0635's can be enabled.

Network Channel

Communication between the Bluetooth mesh 2I2O monitor and the Data Manager is dependent on the same network channel being selected in both units. The [Data Manager Bluetooth mesh page](#) must be configured before logging on any 2I2O monitor. The Data Manager can be set to either Net 0, 1, 2 or 3. This allows a number of Bluetooth mesh networks to operate in the same area without interfering with each other.

The network channel switch on the 2I2O allows the monitor to be configured to operate on the desired Data Manager's network channel. The following switch positions determine the net channel in use.

Both switches down = Net 0
 Switch 1 up 2 down = Net 1
 Switch 1 down 2 up = Net 2
 Switch 1 and 2 up = Net 3



Switch 1 Switch 2

In the above image both switches are in the down position.

Note: If the network channel in the Data Manager is altered then each 2I2O monitor will have to have its network channel changed accordingly and each unit will have to be power cycled so that they acquire the new network settings.

Network ID

The 2I2O monitor has three rotary switches for network addressing. The monitors have an auto-initialise function, which will automatically log the device onto the site network when the rotary switches are set to the desired address. If the rotary switches are set to '123' then the device will log on to the Data Manager and appear in the device list as RC12-3.

If the wrong address has been entered into the monitor or the ID must be changed then the following procedure must be followed;


- Power down the monitor
- Set the three rotary switches to '000'
- Power up the monitor and leave powered for +5 seconds
- Power down the monitor
- Set the three rotary switches to the new ID and power it back on.

Note: The incorrect/ old address may have to be deregistered from the Data Manager.

If the rotary switches are set to '999' then the monitor will not log on to the Data Manager but will act as a [repeater](#) for the network traffic.

LED Operation

The LED represents the Bluetooth network traffic. This will flash on/ off at 1 second intervals when the monitor is in range of the Bluetooth Access Point and has logged on to the Data Manager.



LED



Please ensure all power is switched off before installing or maintaining this product.

Bluetooth Access Point


The Bluetooth Access Point comes in two hardware platforms both similar in function; A PR0632-DIN or a PR0632-SF. Both units are setup using the same method.

Note: The Bluetooth Access Point unit will only work with DM software V3.2.1 and above.

Note: The access point should be connected and powered up before adding Bluetooth devices.

PR0632-DIN

The DIN rail mountable PR0632-DIN has the below connections.

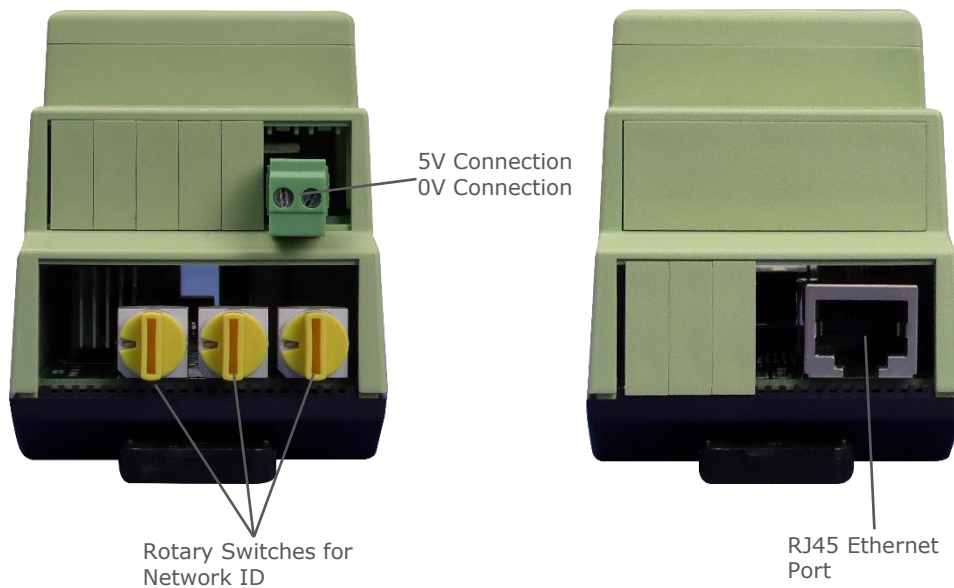

The gateway itself must be powered by a 5Vdc supply and connected to the Data Manager via a standard Ethernet IP network.

The three rotary switches can be adjusted depending on the network it is connected. See [IP Configuration](#) for more details.

From this point the gateway must be configured as outlined in the [Bluetooth Mesh Setup on a Data Manger](#) section.

Note: - The PR0632-DIN comes supplied with a 5v Din Rail mount PSU



Please ensure all power is switched off before installing or maintaining this product.

PR0632-SF

The wall mountable PR0632-SF has the below connections.



The PR0632-SF has the options of being powered by either a 5Vdc supply or by using Power over Ethernet (PoE) and then connected to the Data Manager via a standard Ethernet IP network. RDM's PoE injector kit can be utilised to supply power (PR0619).

The three rotary switches can be adjusted depending on the network it is connected. See [IP Configuration](#) for more details.

From this point the gateway must be configured as outlined in the [Bluetooth Mesh Setup on a Data Manger](#) section.

Note: - The PR0632-SF comes supplied with a 5v External Desktop PSU. The PR0632-SF-NOPSU comes without a 5v external desktop PSU allowing the user to purchase RDM's PoE injector kit (PR0619)



Please ensure all power is switched off before installing or maintaining this product.


Option 1 – Direct Power Supply – PR0632-DIN/ PR0632-SF

There are two methods to which the Bluetooth Access Point can be connected to the Data Manager. The first, simply uses its IP interface to directly connect to the Data Manager's Ethernet 0 IP network via a CAT5 cable where the Bluetooth Access Point is powered from a direct power supply (5Vdc).



Option 2 – Power over Ethernet (PoE) – PR0632-SF-NOPUSU

The second utilises the Power over Ethernet standard (PoE) where the POE Injector can be ordered (PR0619) separately. In this instance the Bluetooth Access Point is powered directly via the CAT5 lead and would require no additional power supply. The PoE injector is powered separately and is connected directly to the Ethernet 0 network of the Data Manager (LAN IN). The second IP (LAN OUT) port of the injector will be to communicate and power the Bluetooth Access Point.

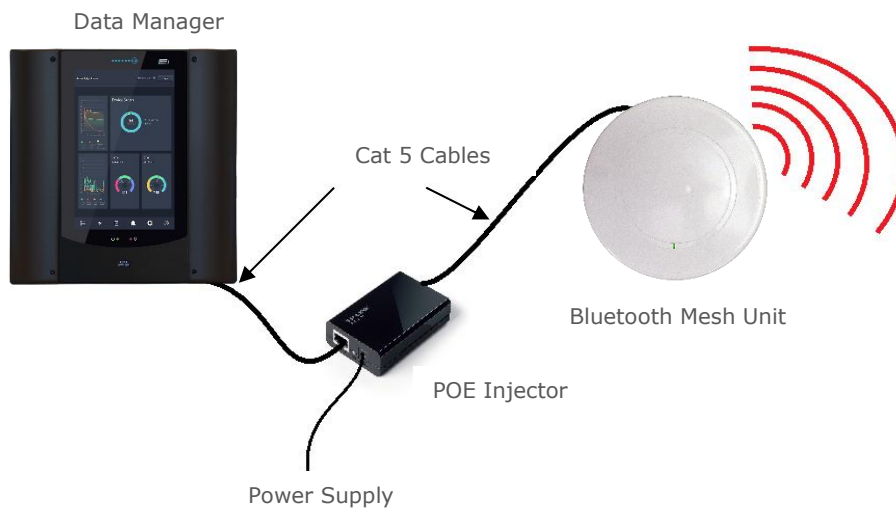

Please refer to the CAT5 standard with regards to maximum cable lengths. The POE injector will supply power up to 100m of cable.

Note: - The PR0632-SF or PR0632-SF-NOPUSU do not come supplied with a PoE (Power over Ethernet) injector.



Please ensure all power is switched off before installing or maintaining this product.

IP Configuration

For the Bluetooth Access Point to connect to a DMTouch its IP address must be configured and connected to the Eth0 interface. The IP address of the module is dependent on the rotary switch positions. The table below shows the configuration.


Rotary Address	IP Address Range
001 to 254	<p>The module is set to operate in the 10.1.2.XXX range with the last part of the IP address being a number between 1 and 254. The last part of the IP address determined by the rotary switch address entered.</p> <p>For example, if the rotary switch address is set to '150' then the module will be assigned the address 10.1.2.150.</p>
301 to 555	<p>The module is set to operate in the 192.168.0.XXX range with the last part of the IP address being a number between 1 and 254. The last part of the IP address is determined by the rotary switch address entered.</p> <p>Rotary address 301 equates to 1, 302 is 2 etc up to address 555 which is 254. If you add 300 to the last part of the desired IP address it will provide the required rotary switch setting.</p> <p>For example, if the desired IP address is '192.168.0.150' then the module rotary switch address will be '450'.</p>
000 or 999	<p>The module is set to DHCP mode and will request an IP address from network. Set '999' and power on the module.</p>
Remaining Addresses	<p>The remaining rotary switch addresses are reserved for future use and should not be used.</p>



Please ensure all power is switched off before installing or maintaining this product.

Multiple Bluetooth Access Points

The Data Manager can support up to four Bluetooth Access Points (any combination of PR0632-DIN and PR0632-SF). This is advantageous should the Bluetooth network be split across multiple floors in a building. Shown below is a simplified network configuration with two Bluetooth Access Points.

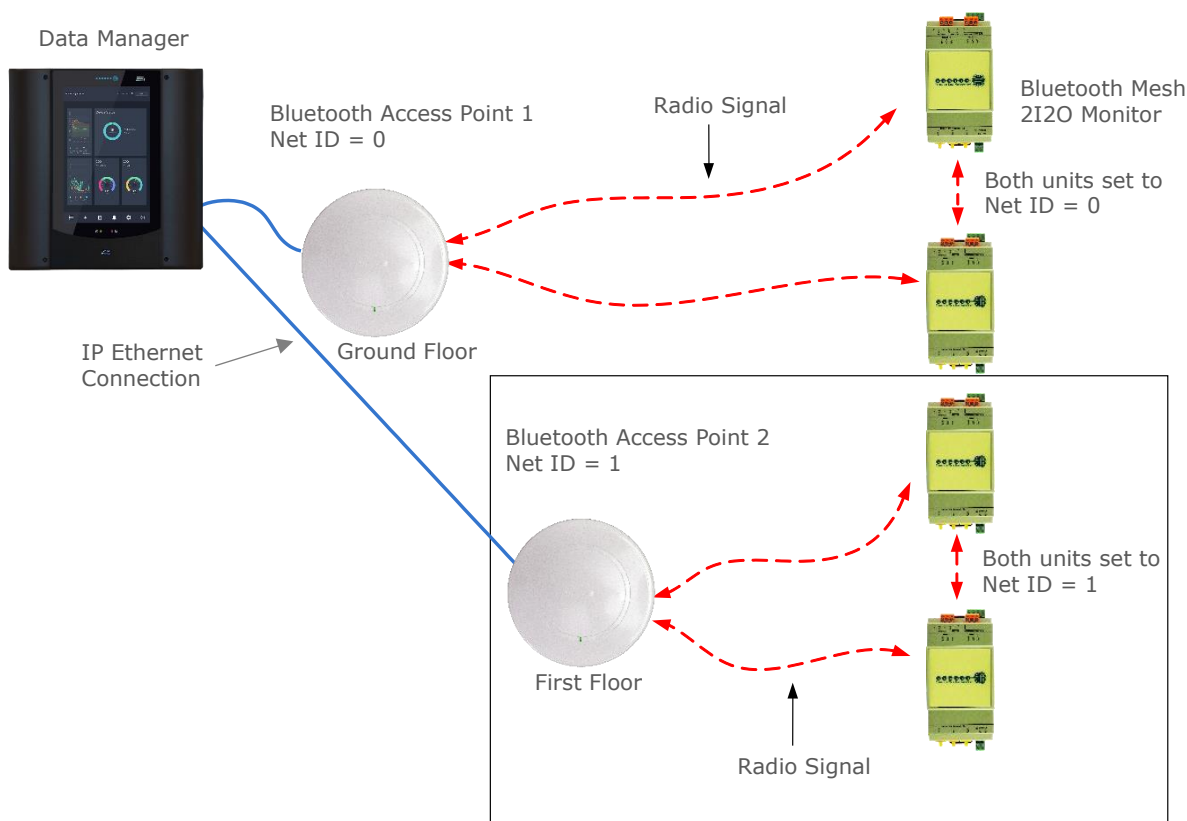

In the example above, two Bluetooth Access Points are connected to a Data Manager via Eth 0. One is configured as Net ID 0 and the other as Net ID 1. One is installed on the ground floor of a building and the other on the first floor. By setting the Net ID on the 2I2O monitors to the appropriate Net ID (set within the Data Manager) the associated monitors can be logged on to the desired Bluetooth Access Point.

Note: 2I2O monitors can only communicate with other Bluetooth mesh monitors or a single base unit which are set to the same Net ID.

Logging on a 2I2O Monitor to the Data Manager

The following steps should be followed when logging on a 2I2O monitor to the Data Manager. See also [Mounting and Installation Instructions](#)

- Ensure the Data Manager has software version V3.2.1 or above.
- Ensure the Bluetooth Mesh interface (PR0635) is enabled in the Data Manager 'System Configuration'.
- Configure the Bluetooth Access Point as detailed in the [IP Configuration](#) section.
- Now connect the Bluetooth Access Point to the Data Manager via an Ethernet cable.
- Configure the [Bluetooth Network Setup](#) page in the Data Manager. Add the desired Access Point and set the desired 'Network ID'.
- Set the [Network Channel](#) on a given 2I2O monitor to match that of the Data Manager you wish to log the monitor on to.
- Now set the three network ID rotary switches on the 2I2O monitor to the desired address and power up the monitor.
- After a short duration the 2I2O monitor will appear in the Data Manager's device list. At this point check and edit the [parameters](#) if necessary.
- If the monitor does not appear follow the instructions within the [Network ID](#) section.

When commissioning a site for the first time start by logging on the 2I2O monitors closest to the Bluetooth Access Point before working out towards the 2I2O units which are furthest away.



Please ensure all power is switched off before installing or maintaining this product.

Parameter Table

Once the 2I2O monitor has been addressed and has logged onto the Data Manager the following parameters can be reviewed and changed if necessary.

Parameter	Range °C (°F)	Step	Units	Default °C (°F)	Comments
Probe Type	PT1000 NTC2K 470R 700R 3K NTC2K25 5K 6K NTC10K NTC10K (2)	N/A	N/A	PT1000	Select the desired probe type. NTC10K (2) = USA
Channel 1 Select	Off Probe Plant N/C Plant N/O	N/A		Probe	- Channel not used - Temperature probe - No 0 volt return signal = 'Plant 1 Fault' - 0 volt return signal = 'Plant 1 Fault'
Chan 1 Prb Slug	No Yes	N/A		No	Electronic slugging. Applies a damping factor which is used to make a standard probe have the same temperature response as a mechanical product probe.
Channel 1 Offset	-10 to +10 (-20 to +20)	0.1	Deg	0.0 (0.0)	Allows the user to offset the measured temperature reading to account for long cable runs.
Chan 1 UT	-90 to +128 (-130 to +260)	0.1	Deg	-2.0 (-28.4)	Channel 1 Under temperature alarm
Chan 1 OT	-90 to +128 (-130 to +260)	0.1	Deg	5.0 (41.0)	Channel 1 Over temperature alarm
Chan 1 Alm Dly	00:00 to 99:00	01:00	mm:ss	20:00	Alarm delay for OT, UT and Plant fault alarms on Channel 1.
Channel 2 Select	Off Probe Plant N/C Plant N/O Defrost			Probe	- Channel not used - Temperature probe - No 0 volt return signal = Plant 2 Fault - 0 volt return signal = Plant 2 Fault - 0 volt return signal = Probe 1 Defrost active
Chan 2 Prb Slug	No Yes			No	Electronic slugging.
Channel 2 Offset	-10 to +10°C (-20 to +20)	0.1	Deg	0.0 (0.0)	Allows the user to offset the measured temperature reading to account for long cable runs.
Chan 2 UT	-90 to +128 (-130 to +260)	0.1	Deg	-2.0 (-28.4)	Channel 2 Under temperature alarm
Chan 2 OT	-90 to +128 (-130 to +260)	0.1	Deg	5.0 (41.0)	Channel 2 Over temperature alarm
Chan 2 Alm Dly	00:00 to 99:00	01:00	mm:ss	20:00	Alarm delay for OT, UT and Plant fault alarms on Channel 2.
Df Recovery	00:00 to 99:00	01:00	mm:ss	20:00	Defrost Recovery Period
Df Overrun	00:00 to 99:00	01:00	mm:ss	60:00	Defrost Overrun
Temp Units	Deg C Deg F	N/A	N/A	Deg C	Select the desired Temperature Unit
Comm Fail Relay	Stay Off On	N/A	N/A	Stay	Controls what happens to the relays when communication failure is detected. Stay - Leaves relays in current state* Off - Turns the relays off (de-energised)** On - Turns the relays on (energised)**
Comm Fail Time	3 to 120	1	mins	5	The number of minutes with no communication from the frontend to be considered a communication failure.

* Unless the unit is powered off and on at which point the relays will default to off until communication is restored.

**If the controller is subsequently powered off and on then the communication fail timer will reset and the relays will go to the default off positions until either communications are restored or the Comm Fail Time expires.

The Comms fail feature is only available when using a DMTouch or minDM. If using a Mini Intuitive or Intuitive or TouchXL TDB controller the relays will stay in their current state (on or off) until communications are restored or the unit is powered off and on at which point the relays will default to off.



Please ensure all power is switched off before installing or maintaining this product.

Defrost

If Channel 2 is set as 'Defrost' and a defrost signal is received then the controller input 'Defrost 2' will change from off to on. Channel 1's control state will now show 'Defrost'. Any OT/UT alarms on Channel 1 will be inhibited during the time the defrost signal is present.

Defrost Overrun

A defrost overrun period can be set into the controller. If the defrost signal is present and exceeds this period the controller will generate a 'Channel 1 defrost overrun' alarm. OT/UT alarms will still be inhibited until the defrost signal is removed even after the Defrost Overrun alarm has been generated. Setting the Defrost Overrun parameter to 00:00 inhibits the feature.

Defrost Recovery Period

After the defrost signal is removed Channel 1 enters the Recovery period. All OT/UT alarms will continue to be inhibited for the duration of the Recovery period. Once the recovery period expires OT/UT alarms will be enabled.

Relay State and functional operation

Relay State	Software State	Wired contact
Relay 1 de-energised	Off	N/O
Relay 1 energised	On	N/O
Relay 2 de-energised	Off	N/O
Relay 2 energised	On	N/O

Network Alarms

The table below shows the text and associated type number that is sent to the system 'front end'. The type number is normally used to provide different alarm actions.

Alarm text	Type # (Index #)
Probe 1 Over Temperature	4
Probe 2 Over Temperature	4
Probe 1 Under Temperature	5
Probe 2 Under Temperature	5
Probe 1 Faulty	6
Probe 2 Faulty	6
Plant 1 Fault	6
Plant 2 Fault	6
Probe 1 Df Overrun	20

Remote Relays

Relays 1 and 2 are available for use as remote relays and have no local control. The relays can be operated via a Data Manager Data Builder program or a Data Manager GP Timer channel. Refer to the appropriate user guide for further information.

Text strings for remote relay use:

Relay Output	Use text string (Data Builder)	GP Timer Output Channel (General)
1	Relay 1	0
2	Relay 2	1



Please ensure all power is switched off before installing or maintaining this product.

GP Timer Configuration

The process outlined below allows a user to operate Relay 1 or 2 from a Data Manager’s GP Timer Channel. From the Data Manager’s ‘Home’ screen, navigate to Service/ Timers/ GP Timers. From the list select a GP Timer channel to configure;

Channel	Description	Status	Type	Output Type	Mask
1	Office Hours	On	Parent	Case	
2	Cafe Fridge Lighting	On	Child (1)	Case	??????
3	Sales Floor Fridge Lighting	On	Child (1)	Case	
4	Warehouse Lights	On	Child (1)	General	LIGHTS
5	Stocking Lights	On	Parent	General	LIGHTS
6	Car Park Lights	On	Parent	General	LIGHTS
7	External Signage	On	Parent	Local Relay	

There are 92 GP timer channels to choose from and a further 8 Global GP timer channels. Once a channel has been selected set the channel to Parent or Child. If set to Parent use the set-up wizard (by clicking on the ‘Add Schedule’ button) to configure the required on/off times and days. If set to Child select a Parent channel from the drop-down list and configure the required offsets.

Once the wizard has been completed, add the relevant information in the other fields:

Channel Type: Parent
 Channel Name: GP Timer Channel 15
 Input Type: Unused
 Output Type: Case
 Output Mask:
 Invert Output: Run-On: Not Allowed
 Schedule:
 Calendar: September 2020
 Key: Daily (Green), Weekly (Purple), Yearly (Blue), Once (Pink), Period (Orange)
 Period 1: to
 Period 2: to

- Channel Name** Enter a meaningful name; e.g. ‘Bluetooth Mesh Monitor (Relay1)’.
- Output Type** Set this field to ‘General’.
- Output Mask** Set this to the controller’s name you want the GP Timer to act on; e.g. ‘RC00-1’.
- Output Channel** Set this to the output number of the relay you want the GP timer channel to act on. Note that this field starts at zero; so if setting it to 0 will operate on Relay 1, 1 would act on Relay 2.

Click the ‘Set Channel’ once all the field values are correct. The relay will now operate as and when the configured GP timer channel status changes.

Another GP channel can be used to configure the remaining relay. Input types can be used to change the current status of the GP Timer channel configured. Please see the Data Manager’s User Guide for further details.

Note: any given relay output can only be controlled by a single GP Timer channel.




Please ensure all power is switched off before installing or maintaining this product.

Data Builder

Using a TDB program running on a DMTouch, miniDM or Intuitive TDB Controller, the user can pull in values from the Inputs and control Outputs on the 2I2O Monitor.

To read information into a TDB program, the user would use an Analog Input block with the following setup: -


Type	This must be set to 'Network'.
Device	Enter the controller's name as it appears in the device/network list e.g., 'RC26-1'.
Value	Enter the input you would like to pick up, making sure the name matches exactly the same as on the item is displayed (including upper- and lower-case characters)

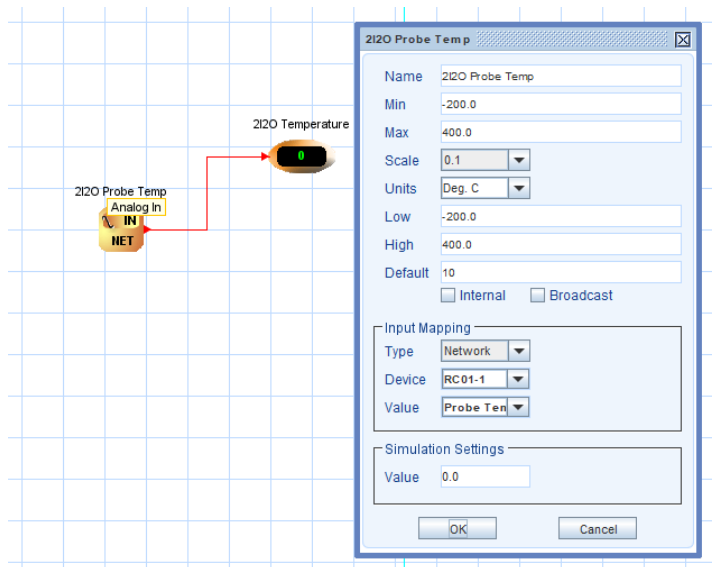

The process below allows a Data Builder program to operate Relay 1 or Relay 2 in the 2I2O monitor using a Digital Out block.

Type	This must be set to 'Network'.
Device	Enter the controller's name as it appears in the device list e.g., 'RC26-1'.
Value	Enter either 'Relay 1' or Relay '2'.

Once the Data Manger Data Builder program is running and the 2I2O monitor is logged on to the Data Manger then the configured relay output can be controlled via the Data Builder program.

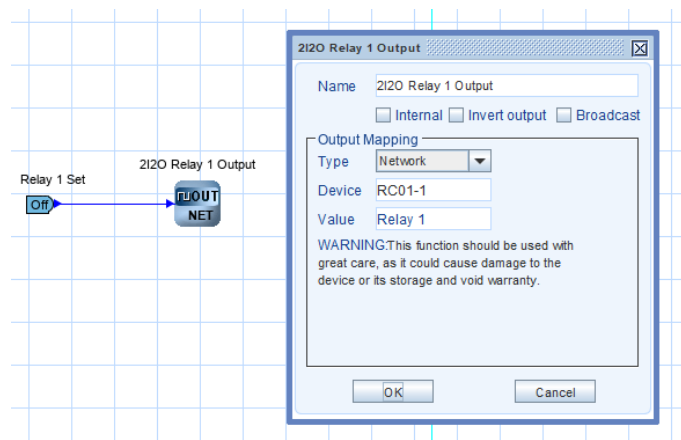

Refer to the Data Manager Data Builder user guide for further details.



Please ensure all power is switched off before installing or maintaining this product.

Technical Specification

Note the product must be used as detailed by the manufacturer, failure to comply may result in the level of protection being affected.

Power Requirements	
Supply Voltage Range	5VDC \pm 10%
Supply Frequency	DC
Maximum Supply Current	0.6A
Typical Supply Current	< 0.3A
General	
Operating Temperature Range	0°C to +50°C (32°F to +122°F)
Operating Humidity	80% maximum
Storage Temperature Range	-20°C to +65°C (-4°F to +149°F)
Environmental	Indoor use at altitudes up to 2000m, pollution degree 2, installation category III.
Dimensions – L x W x H	110mm (4.3in) x 52.5mm (2in) x 68mm (2.7in)
Approx. Mass	133g (0.293lbs)
IP Rating	IP20
EMC	EN 61326-1: 2013 EN 55032: 2015 ETSI 301 489-1 V2.2.3 ETSI 301 489-17 V3.1.1 FCC – X8WBT832 ICES-003 Issue 6
Ventilation	There is no requirement for forced cooling ventilation
Insulation	Class III
Origins	Product designed in the UK manufactured in Taiwan
Probe Inputs	
Input Resistance	3.01K Ohms (NTC type probes)
Rated Voltage	3.3V
Measurement Category	CAT I
Mechanical Relay	
Max Contact Current	5A ($\cos \theta = 1$)
Max Contact Voltage	250VAC, 30VDC
Bluetooth	
Bluetooth version	5.0
Operating Mode	Mesh Network
Frequency	40 Channels selectable from 2.4 – 2.485 GHz
Output Power	+4dBm to -20dBm
Receiver Sensitivity	-96dBm
Transmit power	4dBm
Antenna Gain	2.34 dBi
Range	Range is directly dependant on site conditions. Obstacles such as metal structures and the presence of other 3 rd party wireless devices operating in the same frequency range affect the maximum range achievable.
Data rate	125Kbps to 2Mbit/s
Max Number Hops	5
Max Number Devices	64 per Bluetooth Access Point
Bluetooth ® is a registered trademark of Bluetooth SIG.	
NFC	
Frequency	13.56 MHz
Signal Type	NFC-A Type 2 Tag conforming to ISO 14443-3A



Please ensure all power is switched off before installing or maintaining this product.

Range	10mm (0.4in) – 30mm (1.2in) Range dependant on 3 rd party wireless device used to communicate to the NFC on the 2I2O monitor.
Data Rate	106 kbps

Technical Specifications – PR0632-SF/DIN

Power Requirements	
Supply Voltage Range	5VDC ±10%
Supply Frequency	DC
Maximum Supply Current	1A
Typical Supply Current	< 0.5A
General	
Operating Temperature Range	0°C to +50°C (32°F to +122°F)
Operating Humidity	80% maximum
Storage Temperature Range	-20°C to +65°C (-4°F to +149°F)
Environmental	Indoor use at altitudes up to 2000m, pollution degree 2, installation category III.
Dimensions – L x W x H (SF)	193mm (7.6in) x 193mm (7.6in) x 23mm (0.9in)
Dimensions – L x W x H (DIN)	110mm (4.3in) x 52.5mm (2in) x 68mm (2.7in)
Approx. Mass (SF)	305g (0.672lbs)
Approx. Mass (DIN)	121g (0.267lbs)
IP Rating	IP20
EMC	EN 61326-1: 2013 EN 55032: 2015 ETSI 301 489-1 V2.2.3 ETSI 301 489-17 V3.1.1 FCC – X8WBT832 ICES-003 Issue 6
Ventilation	There is no requirement for forced cooling ventilation
Insulation	Class III
Origins	Product designed in the UK manufactured in Taiwan
Ethernet	
PoE Supply Voltage Range (SF only)	48VDC ±10% It's recommended that the product is powered by an IEEE 802.3af compliant power sourcing equipment (PSE).
PoE Supply Protection (SF only)	Short circuit protected
PoE standard (SF only)	Conforms to IEEE 802.3af Power-over-Ethernet (PoE) standard.
PoE Supply Frequency (SF only)	DC
PoE Maximum Supply Current (SF only)	1A
PoE Maximum Typical Current (SF only)	< 0.5A
Ethernet Interface	Conforms to 10Base-T & 100Base-T with Auto MDI/MDIX
Max Cable Length	100m
Bluetooth	
Bluetooth version	5.0
Operating Mode	BLE Mesh Network
Frequency	40 Channels pseudo-randomly selected from 2.4 – 2.485 GHz using AFH
Output Power	+4dBm to -20dBm
Range	Outdoors (Line of sight): 220m (722ft) – 330m (1082ft) Indoors: 10m (33ft) – 50m (164ft) Range dependant on site conditions. Obstacles such as metal structures and the presence of other 3 rd party wireless devices operating in the same frequency range affect the maximum range achievable.
Data rate	125Kbps to 2Mbit/s
Max Number Hops	5 Hops
Max Number Devices	64 per Bluetooth mesh unit
NFC	



Please ensure all power is switched off before installing or maintaining this product.

Frequency	13.56 MHz
Signal Type	NFC-A Type 2 Tag conforming to ISO 14443-3A
Range	10mm (0.4in) – 30mm (1.2in) Range dependant on 3 rd party wireless device used to communicate to the NFC on the gateway.
Data Rate	106 kbps

Maximum Number of Devices per Network

Up to 4 access points can be supported by a single DMTouch. For example, wireless coverage across multiple floors/levels in a building. A DMTouch supports up to a total of 64 Bluetooth Mesh enabled devices*. Note a miniDM and the TDB controller range support up to a maximum of 32 devices.

A software enabler is required per 32 devices (PR0635 or PR0635-MD).

*Devices include the 2I2O, 4I, wireless probes and comms modules.

Related Part Numbers

Description	Part Number
Bluetooth RS232 Controller Communication Module	PR0630
Bluetooth Monitor (2I/2O) including 5v power supply*	PR0631-2I2O
Bluetooth Monitor (4 Input) including 5v power supply	PR0631-4I
Bluetooth Ethernet Surface Mount Access Point including 5v power supply	PR0632-SF
Bluetooth Ethernet Surface Mount Access Point without power supply	PR0632-SF-NOPSU
Bluetooth Ethernet DIN Rail Mount Access Point including 5v power supply	PR0632-DIN
Bluetooth Ethernet Surface Mount Repeater including 5v power supply	PR0632-SF-RPT
Bluetooth Ethernet Surface Mount Repeater without power supply	PR0632-SF-RPT-NOPSU
Bluetooth Wireless Battery Powered Temperature Probe	PR0633
DMTouch & TDB Controller Range Bluetooth Wireless Mesh Enabler (Block 32 devices)	PR0635
miniDM Bluetooth Wireless Mesh Software Enabler (Block 32 devices)	PR0635-MD

*Not available in USA.

Cleaning

Do not wet the controller when cleaning. Clean the front by wiping with slightly dampened lint free cloth.

Mounting and Installation Instructions

The installation instructions apply to both the 2I2O monitor and the Bluetooth Access Point.

- When installing the 2I2O monitor try to avoid physical obstacles which block direct line of sight with the Bluetooth Access Point such as brick walls, metal structures etc. as this may reduce the effectiveness of the radio signal.
- The Bluetooth Access Point should be mounted centrally within the installation in relation to the majority of the 2I2O monitors. Care must be taken to position the Access Point away from physical obstacles so that the Bluetooth Access Point can be detected by most Bluetooth 2I2O monitors.
- As with all radio equipment avoid mounting the monitor nearby other electronic equipment as to minimise the possibility of interference.
- When mounting the monitor avoid metal surfaces, where possible, to maximise the radio signal range.
- Avoid mounting the 2I2O monitor in between two metal surfaces and do not install the product inside metal enclosures.



Please ensure all power is switched off before installing or maintaining this product.

Network Repeater

If communication issues are encountered setting the rotary switches on a 2I2O or 4I monitor to '999' will enable the monitor to act as a repeater module for the network traffic. The repeater module will not appear on the Data Manager as a device. This module can then be placed in between the Bluetooth Access Point and the problem monitor(s).

Note: Each repeater allows a maximum of 10 devices.

RDM recommends that at least one repeater is used for every 8 devices. This should ensure that there is enough coverage to create the Bluetooth mesh network for each module to communicate back to the DMTouch. The repeaters should be located in places to help the mesh network spread across the area that the probes are located in.

Warranty Information

www.resourcedm.com/terms-and-conditions/

Disclaimer

The specifications of the product detailed in this document may change without notice. RDM Ltd shall not be liable for errors or omissions, for incidental or consequential damages, directly or indirectly, in connection with the furnishing, performance or misuse of this product or document.

Revision History

Revision	Date	Changes
2.1	03/11/2020	First Release
2.1a	18/12/2020	DM compatibility version added
2.1b	15/03/2021	Note added to advise product comes with power supply.
2.1c	02/04/2021	Note added regarding devices logging on over multiple access points
2.1d	28/09/2021	Analog input information added to Data Builder section.
2.2	11/03/2023	Added the ability for probe slugging.
2.2a	03/02/2023	Note added for the number of repeaters recommended.
2.2b	07/03/2023	Note added to network repeater.
2.3	02/06/2023	New comms fail parameters added.



Please ensure all power is switched off before installing or maintaining this product.

Group Offices

RDM Group Head Office

80 Johnstone Avenue
Hillington Industrial Estate
Glasgow
G52 4NZ
United Kingdom

+44 (0)141 810 2828
support@resourcedm.com

RDM USA

9441 Science Center Drive
New Hope
Minneapolis
MN 55428
United States

+1 612 354 3923
usasupport@resourcedm.com

RDM Asia

Sky Park at One City
Jalan USJ 25/1
47650 Subang Jaya
Selangor
Malaysia

+60 3 5022 3188
asiatech@resourcedm.com



Visit www.resourcedm.com/support for more information on RDM solutions, additional product documentation and software downloads.

While every effort is made to ensure the information given within this document is accurate, Resource Data Management Ltd shall not be liable for errors or omissions, for incidental or consequential damages, directly or indirectly, in connection with the furnishing, performance or misuse of this product or document. All specifications are subject to change without notice. See www.resourcedm.com for terms and conditions of sales.